

COMMUNICATION AND SECURITY IN CURRENT INDUSTRIAL AUTOMATION

Dr. György Kálmán
gyorgy@mnemonic.no

| Agenda


-
- Connected systems – historical overview
 - Current trends, concepts, pre and post Stuxnet
 - Risks and threats in a connected automation system
 - Security – logical (cyber) and physical security. Relation to Safety
 - Network security (defense-in-depth, restrictions, remote access)
 - Hardening best practice
 - Common effort
 - Connection to office solutions
 - Managed security
 - Current example: smart grid
 - Outlook: Internet of Things

| Connected Systems

Historical overview

- Components
 - PLCs, controllers
 - End nodes: Sensors, actuators, drives
 - Workstations
 - Servers
 - Infrastructure components: switches, routers, firewalls
- Evolution from serial lines to connected plant
- Information aggregation creates value!
 - Connection to ERP, customers, suppliers etc.
 - Metrics, scheduling, history, maintenance, quality assurance


Architecture Overview

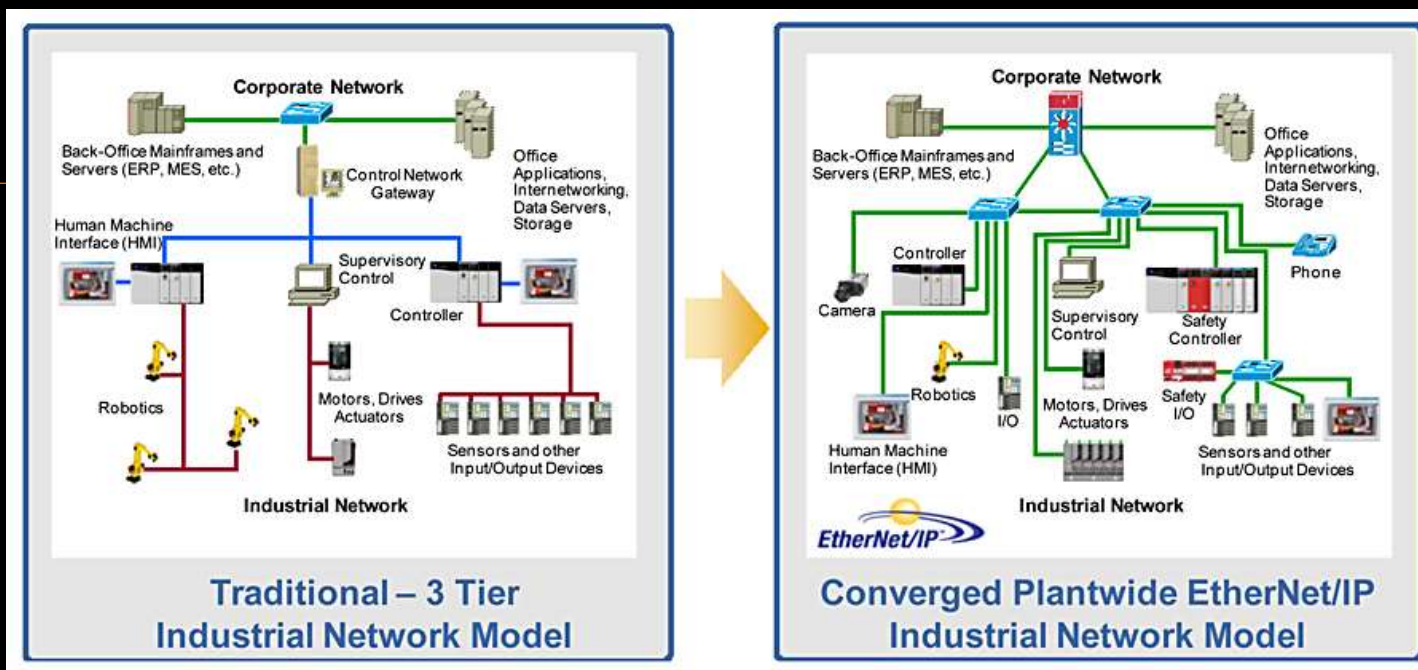

http://www.rockwellautomation.com/resources/images/rockwellautomation/industries_applications_solutions/ether_net_ip/INM_Graphic--custom.jpg

■ Risks and Threats in a Connected Automation System

- Safety as reactive protection, security as preventive protection.
- Physical: theft, disasters, unauthorized access, sabotage
- Logical: Denial of Service, Management, worms and viruses, sabotage, access control, unintended actions
- Safety, risk and consequences in industrial systems
- Safety: freedom from unacceptable risk. Safety systems work against natural processes, not against e.g. sabotage
- Pre- and Post-Stuxnet: fall of the myth of the air gap
- Stuxnet: targeted attack on Siemens equipment: invalid operation envelope, results in catastrophic failure of the equipment. Disables alarms.
- Should address both cyber and physical threats and include interfaces to non-automation related parts of the system.
- Mobile or temporary nodes
- More than just access control and communication security:
 - Tamper resistance
 - Intellectual property protection
 - Data confidentiality

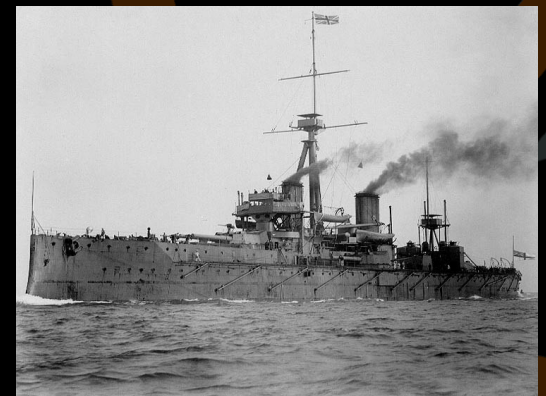

| Security of a system

Security policies influence the whole ecosystem

- A combination of network solution, software environment and applications used.
- Security is a process, not a one-time delivery
- Defense-in-depth: approach the full picture:
 - Device
 - Application
 - Computer
 - Network
 - Physical
 - Policies/Procedures/Management
- Restrictions
- Remote access

Managing risk in industrial deployments

Identify vulnerabilities, threats and aim to reduce frequency and consequence

- Main goal of (industrial) security is to reduce risk
- To reach this goal, it can cooperate with other industrial solutions: redundancy in installations or safety systems.
- React on security breaches – if possible, in cooperation with the automation equipment (safety)
- In this case, one can use also physical safety: burst disc, protective casing, automatic fire extinguisher, intrinsic safety, containment, plant or community emergency response etc.
- Common cause failures: interaction between safety and security
- Very similar tactics: separation, diversity, verification and validation

Physical security

Traditional methods for securing an environment

- Limit access to authorized personnel
- Physical security:
 - door, wall, fence, lock, protective casing
 - security guard,
 - Includes protection of communication channels (e.g.: cabling, but also USB ports).
- Procurement
- Destruction of used equipment

| Network security

Restricting the default accept-all policy

- Not a long history in industrial automation
- Most devices have no features for communication security
- Adaptation of office solutions to the industrial environment
 - Traffic composition -> mostly L2, some L3
 - Cost and openness
- Interesting connection point between the industrial applications and financial operations: data integrity, QoS and protection of devices.
- Problematic to have IDS/IPS down to control/field level
- Configuration and protection of ports (including physical)

| Hardening Best Practice

Topics

- Policies
 - Typical accept-all to allow coexistence, secured with configuring for the actual system -> hard to create a standard setup (will show a bit later, why this is not completely true)
- Access for third parties
- Computer management:
 - Patching
 - Antivirus: all suitable computers shall be scanned regularly. It is a question how to implement without impact to performance.
 - Policy for usage and software installation
 - Configuration of interfaces, physical security
- Access and Account management
- Backup
- Topology



| Hardening Best Practice

Topics


- Security policy: standards compliance (IEC 62443, ISO 27000)
- Patch management and AV (centralized AV solution, own update server for patch management)
- Default settings and hardening (OS setup, firewall, user settings, ports, interfaces, mobile storage)
- Access and account management (RBAC, password policy)
- Backup and recovery (disaster recovery strategy, also test)
- Plant network topology (security zones)
- Secure remote access
- Security monitoring and diagnostics (IDS/IPS, network management)
- Hardware and software inventory
- Application whitelisting
- Validation: scan with e.g. Nmap, Tenable Nessus



| Communication setup

Securing the communication path

- Separate industrial network from office network
- (Mutually) don't trust third partner connections
- If needed, secure the communication path as far down towards the controller as possible. Typical for SCADA applications: VPN is only terminated inside the remote station or even only at the controller (depending on type).
- Use network zones: create DMZ for data exchange, deny-all default policy for firewalls
- Use security functions in protocols where available
- Security shall not compromise network QoS
- Use secure protocols for network management
- Office-features are being introduced also in the automation domain: including smart switches, network management systems, patch management, traffic monitoring
- Development direction: cut engineering costs: automatic configuration, mass configuration, use of templates

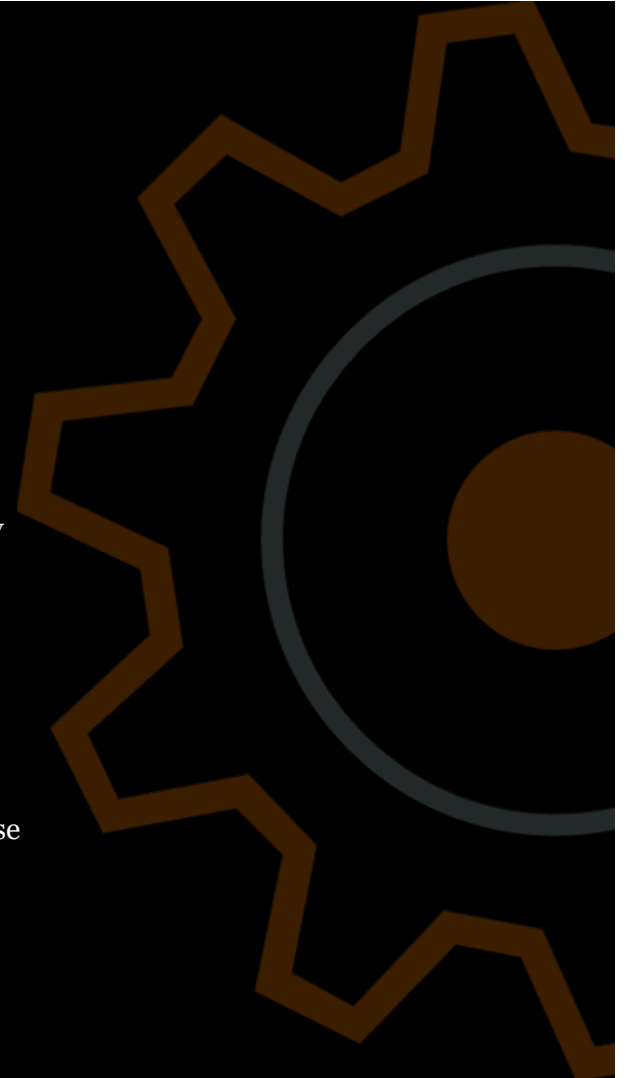

| Access Control Lists

Key feature for access control

- Access Control Lists (ACLs) are commonly used for configuration of network equipment: the lists lead to easier and more consistent setup of devices.
- Can be applied on network equipment, servers and other nodes, which will all follow the (same) rules defined by the list.
- Key setting: if something is not defined in the ACL, then it will be denied.



| Firewalls

Maintaining Quality of Service

- Office solutions are not directly applicable: different traffic requirements and traffic composition
- Stateful packet inspection: fast and can be effective in an industrial environment, sometimes the only automatic solution which can meet delay/latency/jitter requirements
- For larger installations: follow the same standard policy for all remote stations and use the same rule set as much as possible
- Allow communication directly between zones only if required.
- Set up security zones – implement defense-in-depth (IEC 62443)
- Users shall not be able to access services, which are not necessary for the operation. Access to these can be granted through a less secure network.



| Virtual Private Networks

Historical and network security reasons

- Historically most of the automation protocols ran on L2 (still today, mostly in the control and field networks)
- If one needed a shared setup, where e.g. the controller was in a different location than the actuators and sensors, the non-routeable protocols were a problem (earlier with leased lines this was not an imminent problem)
- VPN is a solution for an L2 protocol to be carried over an L3 network transparently
- On the other side, it can also provide integrity and confidentiality
- Cost press leads to use shared networks to convey information from automation sites: VPN is today a necessity.



| Network Segmentation

For security and availability

- Segmentation of networks is by default required by the automation products (sometimes «weird» behavior and sensitivity)
- Separation of network traffic and shared infrastructure
- Routers and firewalls (including controllers) shall be configured with being aware, that L2 segmentation is not separating L3 traffic.
- Bad practice: but sometimes required because of configuration cloning:
 - Two electric substations having exactly the same L2/IP/server setup, only being different in the physical location, but connected to the same higher network
- Use VLANs for segregation of traffic and easier network management
- use IEEE 802.1X on the edge ports.
- No direct communication between the office and the automation network -> DMZ between office and industrial.



| Computers

Remove or disable unnecessary components

- Centralize management
- AV where required and possible
- Remove unnecessary file shares, services
- Disable physical interfaces not in use
- Firewall, where QoS requirements allow. Deny all as default.
- Role Based Access Control recommended
- System management: central patching, no unauthorized software deployment, limit or disable the use of removable storage



| Controllers

Securing the key component of the automation system

- Adequate protection of communication: integrity, confidentiality on demand, change management, access control
- Availability is more important than confidentiality
- Physical security: protect interfaces and access to the actual device (local interface always available, at least a DoS attack is possible)

- Always change default username and password
- Protect the program, if possible enable firmware fingerprint checking
- Disable all unused features (including services and ports)
- Protect against unintentional threats
- The controller acts as a router/gateway between the control and field networks, configure accordingly



| Common Effort

Industrial actors, governments and standardization bodies

- Best practice
 - [ABB](#)
 - [Rockwell](#)
 - [Siemens](#)
- Standardization
 - IEEE 1588 v3
 - IEC 61850
 - IEC 62443 (ISA-99) Industrial Automation and Control Systems Security
 - NIST 800-82 Industrial Control System Security
- ICS-CERT
- KraftCERT
- Laws protecting the infrastructure and requiring actors to exchange security incident information



| Comparison to office environments

Process and environmental constraints limit the applicability

- An automation system has a connection to the physical world.
- Loss of information or other QoS violation might lead to physical consequences
- Security focus is more spread: central elements like servers, controllers and sensors/actuators

- Availability: 4-5 sigma. Much less is expected in office.
- QoS: much more strict in automation, only finance has similar, jitter is especially critical
- Typical communication: person to person vs machine to machine
- Reaction to problems: wait/reboot/call -> minute-hour range in office compared to instant failover redundancy, fail-safe or fail-operational paradigm, repair in operation.
- More deterministic communication can make some office solutions more effective

- Reactive security: Managed Security Services, continuous vulnerability analysis

| Smart Grid example

Security and privacy in the smart grid

- The power grid is a typical example for a SCADA operation
- Continentwide critical infrastructure
- Smart grid is expanding this infrastructure
- Smart meters introduce a device located in the home network, but also connected to the grid control
 - Physical security
 - Tampering
 - Secure communication channel
 - Maintenance
- Unusual attack vectors with one interface in the home, one at the utility
- Time synchronization is a challenge: heterogenous networks, problematic timing measurement in multihop wireless.
- Balance between reliability and security, [ABB White Paper](#)



| Internet of Things

Automation moves to the internet

- Still automation: M2M, QoS, predictable behavior, restricted resources
- Managed security and active defence solutions from office
- New market possibility for 5G mobile
- It is already here with consumer electronics
- Coming in SCADA, transportation, process control and healthcare
- SDN

- Literature: [IoT overview](#), [Ericsson](#), [Accenture](#)



| Applicability of SDN to industrial automation

Intelligence in the network or in the nodes?


- Cost press and manual configuration
- Network Management System is typically not used
- Examining the possibility to use SDN
 - Single point of failure -> safety
 - Reaction on security issues
 - Mass configuration, as-built analysis, network management
 - Provides utilization information
 - Direct influence on forwarding



| Security engineering with SDN

Precise control of network flows

- Exploit the static traffic composition
 - Control of the forwarding plane
 - Direct QoS evaluation
 - Enforcement of policies
 - Reuse of previous rulesets
 - Documentation generation
- Figure from RedHat

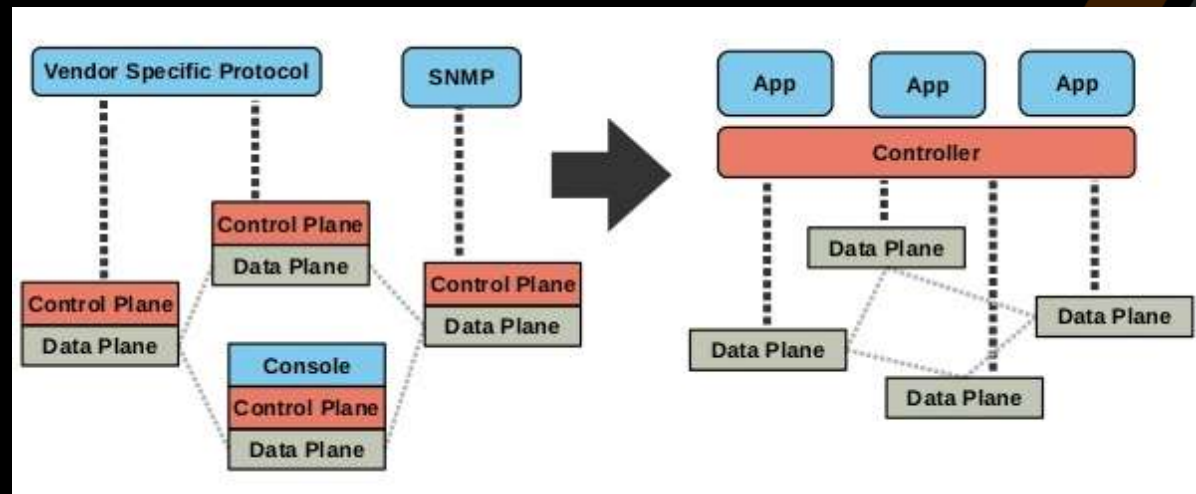

| Conclusion

Structured approach and discipline

- Focus on the task to be fulfilled
 - Drop-all / whitelisting approach
 - Segmentation
 - Mutually not trusting each other
 - Validation
-
- Future: reactive security, traffic monitoring, MSS





mnemonic
- *securing your business*

mnemonic